



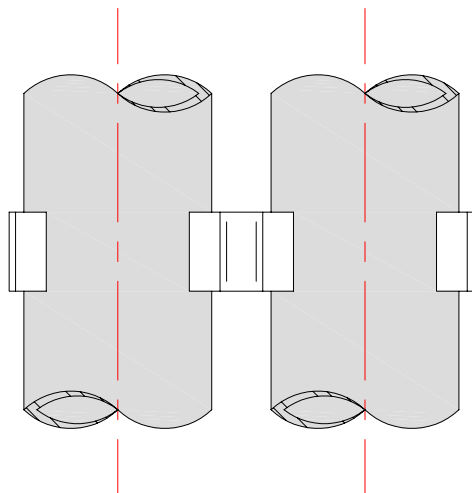

NOTES:

1. USE 4 SPACERS FOR EVERY 20 FEET OF DUCT BANK.
2. CONDUIT IS SUPPLIED BY OTHERS.
3. THE FORCE REQUIRED TO SNAP A SINGLE DUCT INTO THE SPACER WILL BE APPROXIMATELY 18 LBS.
4. THE SPACER WILL BE A SNUG FIT AROUND DUCT.
5. NOMINAL DISTANCE BETWEEN ADJACENT DUCTS AT BELLED ENDS:
 .404 WITH EPC-40-PVC DUCT
 .270 WITH EPC-80-PVC DUCT
6. THIS SPACER IS DESIGNED FOR DIRECT BURIAL APPLICATIONS.
7. THIS SPACER CAN BE USED WITH THE OPEN SIDE UP AS SHOWN OR IT CAN BE INVERTED AND USED OPEN SIDE DOWN.

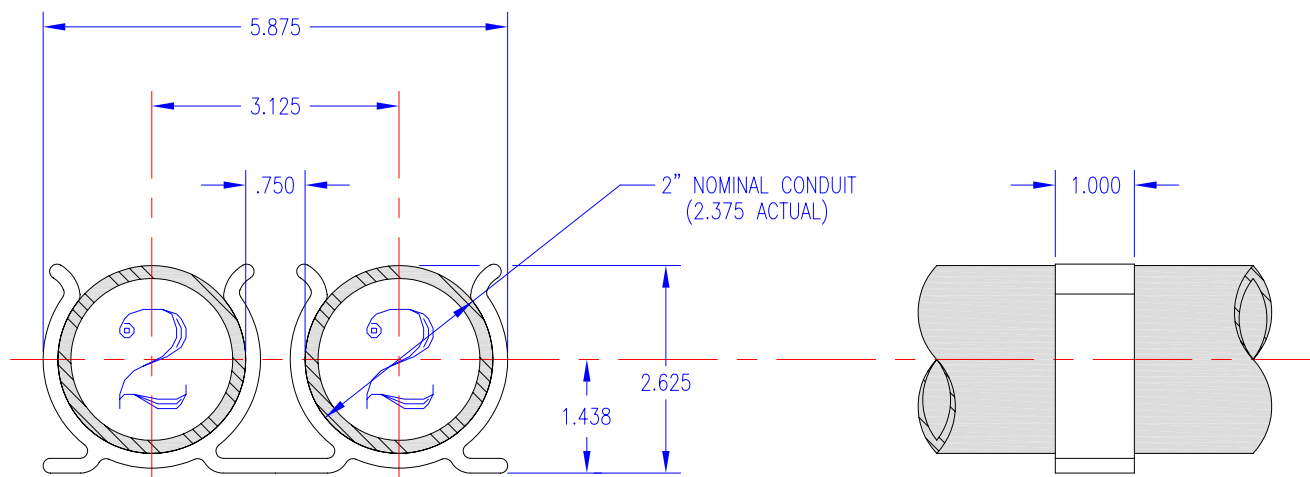

UNDERGROUND DEVICES
CATALOG NUMBER:
2DB08-2

SCALE:



**2DB08-2 WUNPEECE® DUCT SPACER
OUTLINE DRAWING**

SCALE: See At Left	DESIGNED BY: Don McCoy	DRAWN BY: Alan Armstrong	CHECKED BY: Don McCoy
DATE: 9-14-92	APPROVED BY:	REVISION: C 8-23-95	

1st Designed For UDI LIBRARY OF
OUTLINE & INSTALLATION DRAWINGS FOR AutoCAD®

UNDERGROUND DEVICES, INC. NORTHBROOK, ILLINOIS 60062 - PHONE: (708) 205-9000	DRAWING NUMBER: 90-161 PAGE 1 OF 1
---	---